


CAUTION

The 627H, 632H Series detectors have been improved for easier field wiring. An external jumper connecting screw terminals 3 and 4 indicates that the unit was built prior to the change. These units must be wired as shown below.

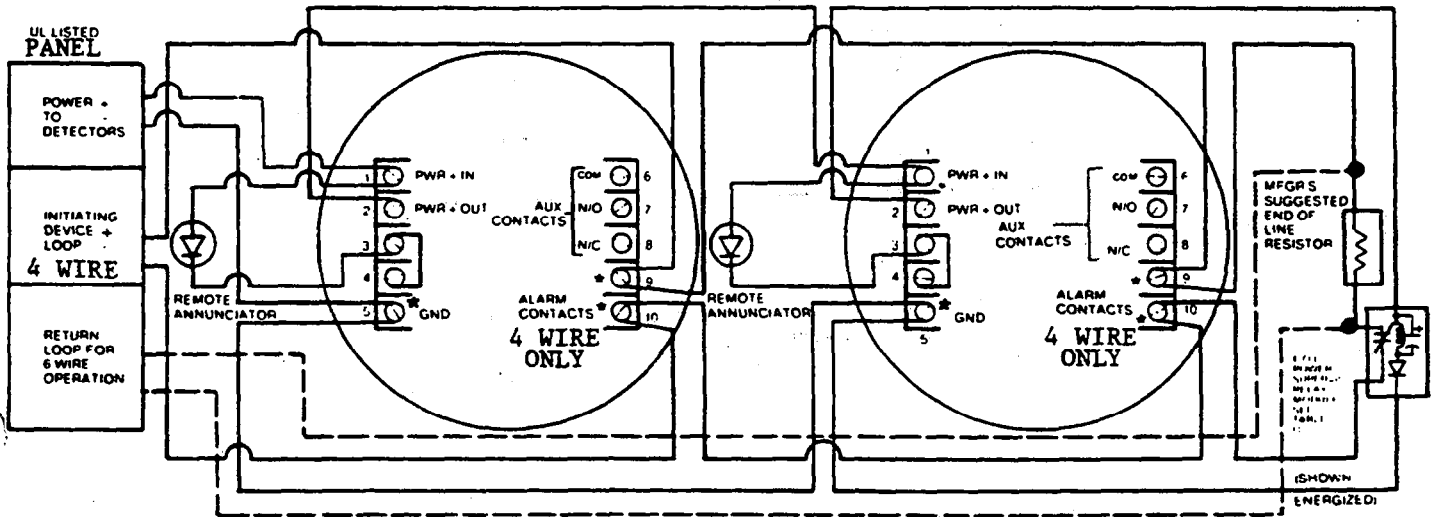

*CAUTION: Do not use looped wire under terminal. These terminals are designed to prevent looping a single wire which requires supervision. The wire

should be cut and stripped of 3/8" insulation on each end and inserted under the clamping plate, one wire on each side of the screw.

All units without this jumper must be wired per enclosed installation instruction, 156-147-00 (or 156-148-00).