

# INSTALLATION GUIDE



333 Bayview Avenue  
Amityville, New York 11701  
For Sales and Repairs, (800) 645-9445  
For Technical Service, (800) 645-9440  
Publicly traded on NASDAQ Symbol: NSSC



## **NAPCO Access NAX-200X Supervised Alarm/Relay I/O Board Model NAX-200XI/O Board Installation Guide**

Please refer to NAPCO NAX-200XI/O Installation Instructions WI1588

# PC Board Layout: Alarm/Relay Board (NAX-200XI/OBD)

## INDICATORS

- **EVENT** - Flashes on/off to indicate a change in any Alarm Input status.
- **OK** - Flashes steadily to indicate a working connection to the control panel.
- **RELAY** - Indicates working power connection via 12V IN.
- **LOGIC** - Working 5 volt power from control panel.
- **LEDs near Relays** indicate activation of individual relay.

## ADDRESS

A jumper must be set to X1, X2, or X3. Each Board must be set to a different address.

## I/O SERIAL SIGNAL and LOGIC POWER

Connect to control panel or pass-thru connector using the modular cable supplied.

**12V IN**  
Powers the relay coils

## SIXTEEN SUPERVISED ALARM INPUTS

May be configured as Normally-Open / Normally-Closed; Supervised (requiring termination resistors) or Unsupervised (requiring plain electrical contacts).

## RELAY CONTACTS

Normally-Open and Normally-Closed contacts available. Contacts rated 2A 24V AC/DC.


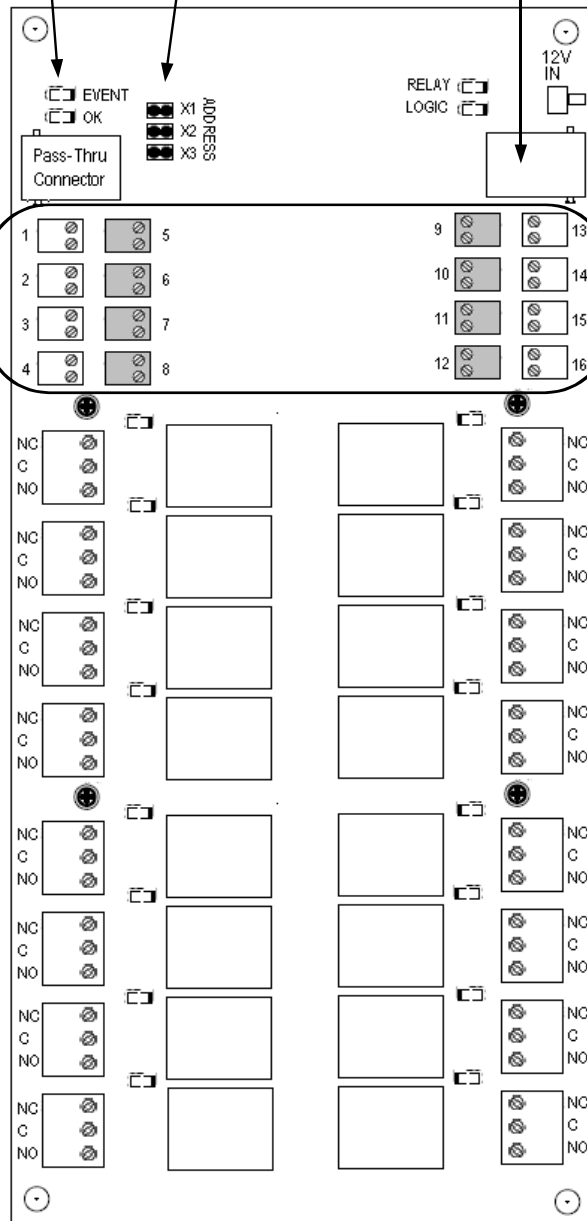


Figure 1 - PC Board Layout

## Installing the Supervised Alarm/Relay (NAX-200XI/OBD) Boards

Locate the four push-on "Snap" Fasteners.

Locate the four 4-40 female PEM Fasteners.

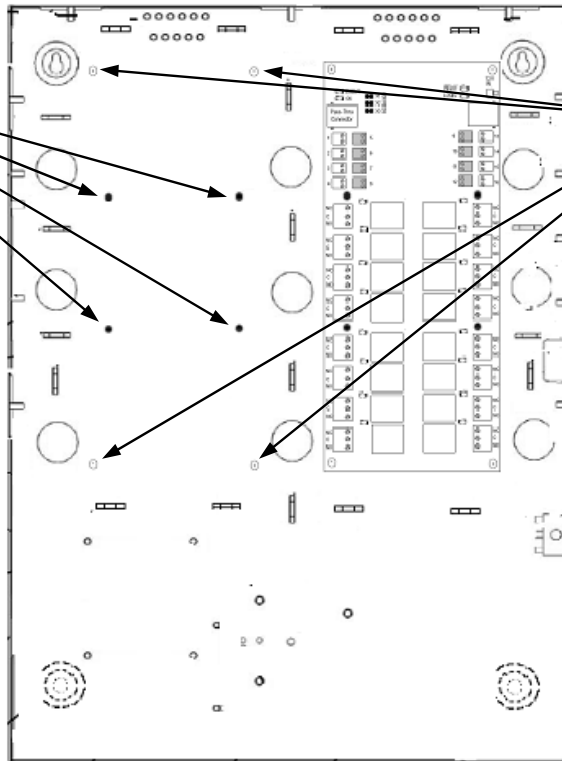

**Note:** Normally, the first Alarm/Relay Board will be installed on the right side.

Position the board so the outer mounting holes line up. Then carefully align the board over the four snap fasteners. Press on the upper eight relays with your palm, applying increasing force while rocking your palm until all four snaps are secured.

Install the four 4-40 screws (provided) in the mounting holes on the outer part of the board.

Figure 2 - Fastener Mounting Locations

Locate the **12V IN** connector on the upper-right of the board.

When being installed in the NAX-200XIO (with the power supply and battery) connect the small white Molex Connector from the cable plugged into **RLY PWR OUT** Connector.

When installed in the enclosure (without the power supply and battery) use the long cable provided to connect to the Accessory Power Connector in the Access Control Panel. Note this cable may be routed with the Modular cable in the same conduit.

Connect the Short Modular Cable (provided) between the two Alarm/Relay boards.

Connect the Long Modular Cable (provided with the enclosure) to the adjacent Super Two panel or another I/O Expansion Unit.

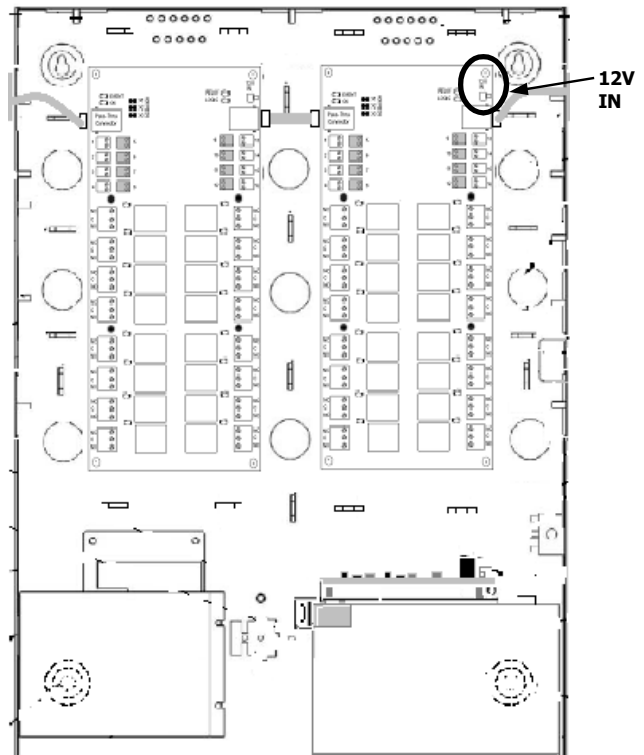


Figure 3 - Power Connection Locations

## SPECIFICATIONS

SPECIFICATION	Quantity	Comments
Relays	16 (each PDB) per panel.	Form "C", contact rating of 2A @ 24V AC/DC 48 maximum per Super Two panel
Alarms	16 (each PDB) per panel.	Supervised or non-supervised (host programmable) 48 maximum per Super Two panel
Status LEDs	16 4	One LED per relay EVENT, OK, RELAY power, LOGIC power
Supply Voltage		12 Volts DC
Current Draw		500mA maximum
Temperature Range Operating Storage		32-115°F (0-46°C) 32-149°F (0-65°C)
Relative Humidity		0% to 85% non-condensing
Link Programs	64	Standard

Cables	AWG	Type	Maximum Length
Alarm Inputs	22 ga	Stranded, shielded, w/drain 2-conductor alarm	500 ft (153m)
Relay Circuits	18 ga	Stranded, shielded, w/drain	500 ft (153m)